




**Recold**

JC Series Evaporative Condenser

Construction ..... 3  
Schematic ..... 4  
Engineering Data ..... 5  
Selection Procedure ..... 6-9  
Multi-Circuited Selection Procedure ..... 10-11  
Accessories ..... 12


### Nomenclature

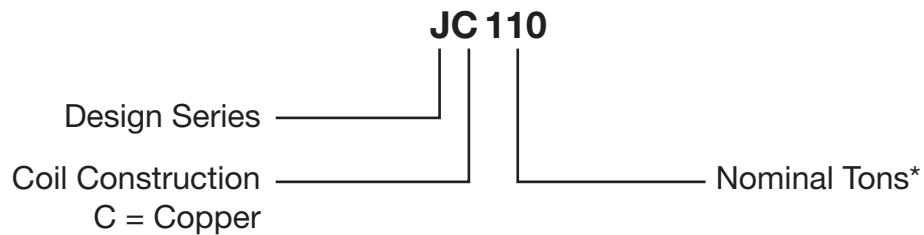

\*At 105°F condensing temperature, 78° wet bulb temperature, 40°F suction temperature, refrigerants R12, R22, R502.

#### RECORD HYDROSPRAY

Recold engineering has developed an exclusive water distribution system called hydro spray. This unique system provides optimum water coverage of the heat transfer coil for maximum efficiency and virtual elimination of harmful scale problems that result from uneven water distribution. This process is accomplished through a limited number of large orifice non-clogging diffusers mounted on a heavy duty PVC pipe water header.

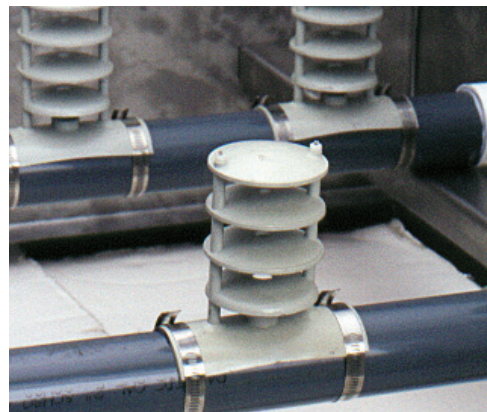

The JC Evaporative Condenser is a ruggedly built unit constructed to provide many years of durable, dependable service with minimal maintenance requirements. Quality materials and workmanship are a key factor in meeting this objective.

### FAN MOTORS

Fan motors furnished as standard equipment are open drip-proof type suitable for outdoor service. Motors have a 1.15 service factor and are mounted on a heavy duty adjustable base located for easy access.

### FAN GUARD SCREENS

All moving parts are protected with OSHA approved galvanized steel screens. Each guard is easily removed for access to the fan.

### FAN SECTION

The centrifugal fan is forward curved, statically and dynamically balanced and constructed of galvanized steel. The fan housing has curved inlet rings for efficient air entry and discharge into the pan. Fans are mounted on a solid steel shaft coated to resist corrosion. Heavy duty, pillow block type, self-aligning ball bearings are located at each end of the fan shaft.

No intermediate bearings are required

Extended lube lines are supplied as standard equipment to allow servicing bearings without removal of fan guard screens.

### WATER CIRCULATION PUMP

The water circulation pump is a close coupled, bronze fitted centrifugal type with mechanical seal. Each pump is factory mounted and piped. Standard motor is open drip-proof suitable for outdoor service.

### DRIFT ELIMINATORS

Eliminators are constructed of PVC assemblies in removable, easy to handle sections. Each section has a three break design allowing three changes in air flow and measure approximately 5 inches in depth. The use of durable PVC eliminates the corrosion problems associated with galvanized eliminators.

### HEAT EXCHANGE COIL

Coil tube bundle is constructed of 5/8" copper tubing with stainless steel tube sheets and copper headers. The copper construction offers a noncorrosive coil for extended service life.

### ACCESS DOORS


Large rectangular access doors are strategically located to provide access to both upper water distribution system and lower pan basin. The patented doors provide a complete air and water tight seal without the use of gaskets or fasteners

### WATER MAKE-UP

Water make-up is provided by a solid brass float valve with arm and float ball installed in an external float box. This allows easy observation of the water operating level and maintenance of the valve with unit in operation.



**Construction:** The Evaporative Condenser sump pan is constructed of 300 series stainless steel and casing panels are constructed of heavy gauge, G-235 galvanized steel. The sump pan and casing panels are flanged outward so that all the connecting fasteners are located outside the flooded section of the unit to help prevent leaks in the unit and provides a more permanent watertight joint. To provide further protection from corrosion, no welded joints are located below the water line. The unit is designed for a 30 psf on any projected area and ships in one piece on a minimum 6" high stainless steel channel base to help in handling and installation of the unit.

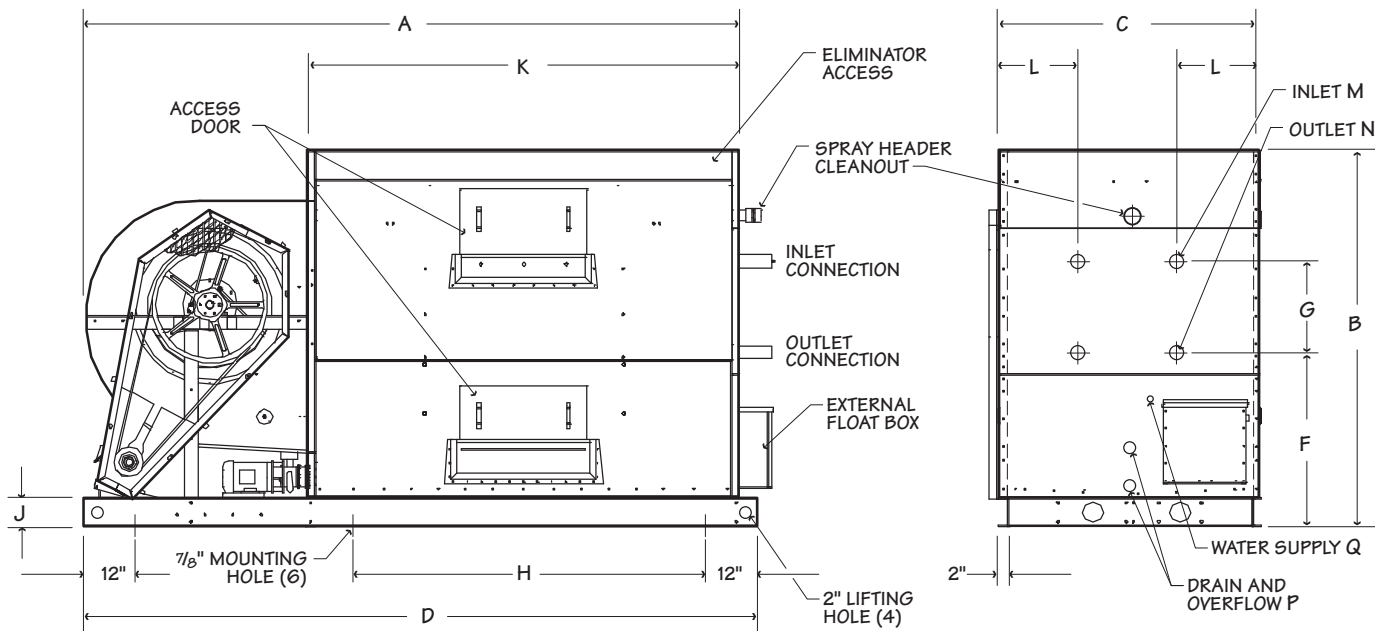

| Model            | Dimensions |          |          |          |         |         |         |     |          |         |            |            | Access Doors |        |           |          | Overflow Drain FPT | Water Supply FPT |
|------------------|------------|----------|----------|----------|---------|---------|---------|-----|----------|---------|------------|------------|--------------|--------|-----------|----------|--------------------|------------------|
|                  |            |          |          |          |         |         |         |     |          |         |            |            | Far Side     |        | Near Side |          |                    |                  |
|                  | A          | B        | C        | D        | F       | G       | H       | J   | K        | L       | M          | N          | Top          | Bottom | Top       | Bottom   | P                  | Q                |
| JC20 thru JC30   | 80"        | 76"      | 32"      | 84"      | 32 1/4" | 20 1/2" | —       | 6"  | 53"      | 13 1/2" | 2 1/8"     | 1 1/8"     | 1            | 1      | —         | —        | 2 1/2"             | 1/2"             |
| JC38 thru JC58   | 96"        | 76"      | 38"      | 102"     | 31 1/2" | 20 1/2" | —       | 6"  | 65"      | 16"     | 2 1/8"     | 1 1/8"     | 1            | 1      | —         | —        | 2 1/2"             | 1/2"             |
| JC63 thru JC80   | 115 1/4"   | 77"      | 46 1/4"  | 124"     | 33 1/4" | 20 1/2" | 51 1/4" | 6"  | 76 1/4"  | 20 1/2" | 2 3/8"     | 2 1/8"     | 1            | 1      | 1         | 1 note 3 | 2 1/2"             | 1/2"             |
| JC90 thru JC120  | 139 1/2"   | 81"      | 56 3/8"  | 144"     | 38"     | 19 1/2" | 51"     | 6"  | 92"      | 14 1/2" | 3 3/8"     | 2 3/8"     | 1            | 1      | 1         | 1 note 3 | 2 1/2"             | 3/4"             |
| JC135 thru JC200 | 172 1/4"   | 92 1/2"  | 67 3/4"  | 180 1/4" | 41"     | 19 1/2" | 71 3/4" | 6"  | 115"     | 17 1/2" | 3 3/8"     | 2 3/8"     | 2            | 1      | 2         | 1 note 3 | 2 1/2"             | 1"               |
| JC240 thru JC285 | 184 1/4"   | 98"      | 94 1/2"  | 192"     | 47"     | 19 1/2" | 84 1/2" | 8"  | 115"     | note 4  | 2 @ 3 1/8" | 2 @ 2 3/8" | 2            | 1      | 2         | 1 note 3 | 3"                 | 1 1/4"           |
| JC320 JC350      | 208"       | 98 1/2"  | 94 1/2"  | 217"     | 47"     | 19 1/2" | 96 1/2" | 8"  | 139 1/4" | note 4  | 2 @ 3 1/8" | 2 @ 3 1/8" | 2            | 1      | 2         | 1 note 3 | 3"                 | 1 1/4"           |
| JC375 JC400      | 221"       | 118 1/2" | 101 1/2" | 225"     | 67"     | 19 1/2" | 80"     | 10" | 139 1/2" | note 4  | 2 @ 3 1/8" | 2 @ 3 1/8" | 2            | 2      | 2         | 2 note 3 | 4"                 | 1 1/4"           |
| JC425 JC450      | 245 1/2"   | 118 1/2" | 101 1/2" | 248"     | 67"     | 19 1/2" | 104"    | 10" | 164 1/2" | note 4  | 2 @ 3 1/8" | 2 @ 3 1/8" | 2            | 2      | 2         | 2 note 3 | 4"                 | 1 1/4"           |
| JC475 JC525      | 269"       | 118 1/2" | 101 1/2" | 273"     | 67"     | 19 1/2" | 128"    | 10" | 188"     | note 4  | 2 @ 3 1/8" | 2 @ 3 1/8" | 2            | 2      | 2         | 2 note 3 | 4"                 | 1 1/4"           |

**Note**

- 1 Use this bulletin for preliminary layouts only. Obtain current drawing from your Recold sales representative.
- 2 If required add 6 1/2" for positive closure dampers.
- 3 An additional bottom access door is installed on the connection end.
- 4 Consult Recold for size and location of connections on multi-circuited coils.
- 5 If supporting the unit on beams, refer to the Recold suggested supporting steel drawing for required mounting hole location.

| Model | Fan Motor<br>hp* | Standard Fan<br>Motor Frame | Sump Heater<br>kW | Sump Capacity<br>gal | Air Volume<br>cfm | Fan<br>RPM | Fan Size<br>in | Coil Face<br>sq ft |
|-------|------------------|-----------------------------|-------------------|----------------------|-------------------|------------|----------------|--------------------|
| JC20  | 2                | 145T                        | 1.5               | 32                   | 3200              | 960        | 18             | 704                |
| JC25  | 2                | 145T                        | 1.5               | 43                   | 5280              | 589        | 18             | 9.7                |
| JC30  | 3                | 182T                        | 1.5               | 43                   | 5900              | 796        | 18             | 9.7                |
| JC38  | 3                | 182T                        | 2.6               | 64                   | 7400              | 601        | 21             | 14.5               |
| JC46  | 3                | 182T                        | 2.6               | 64                   | 7000              | 636        | 21             | 14.5               |
| JC52  | 5                | 184T                        | 2.6               | 64                   | 8500              | 729        | 21             | 14.5               |
| JC58  | 5                | 184T                        | 2.6               | 64                   | 8300              | 740        | 21             | 14.5               |
| JC63  | 3                | 182T                        | 2.6               | 95                   | 9800              | 452        | 25             | 21.6               |
| JC72  | 5                | 184T                        | 2.6               | 95                   | 11800             | 523        | 25             | 21.6               |
| JC80  | 7½               | 213T                        | 2.6               | 95                   | 13000             | 614        | 25             | 21.6               |
| JC90  | 7½               | 213T                        | 4.0               | 163                  | 19000             | 413        | 31             | 32.5               |
| JC110 | 10               | 215T                        | 4.0               | 163                  | 20000             | 462        | 31             | 32.5               |
| JC120 | 10               | 215T                        | 4.0               | 163                  | 19500             | 476        | 31             | 32.5               |
| JC135 | 10               | 215T                        | 5.5               | 248                  | 26500             | 344        | 37             | 49.6               |
| JC165 | 10               | 215T                        | 5.5               | 248                  | 26000             | 356        | 37             | 49.6               |
| JC180 | 10               | 215T                        | 5.5               | 248                  | 24100             | 350        | 37             | 49.6               |
| JC200 | 15               | 254T                        | 5.5               | 248                  | 28400             | 385        | 37             | 49.6               |
| JC240 | 20               | 256T                        | 8.0               | 374                  | 37200             | 385        | 40             | 70.4               |
| JC270 | 20               | 256T                        | 8.0               | 374                  | 36600             | 385        | 40             | 70.4               |
| JC285 | 25               | 284T                        | 8.0               | 374                  | 39000             | 415        | 40             | 70.4               |
| JC320 | 30               | 286T                        | 11.0              | 454                  | 52300             | 415        | 40             | 85.5               |
| JC350 | 30               | 286T                        | 11.0              | 454                  | 50000             | 430        | 40             | 85.5               |
| JC375 | 30               | 286T                        | 11.0              | 748                  | 58300             | 252        | 49             | 92.5               |
| JC400 | 30               | 286T                        | 11.0              | 748                  | 61000             | 267        | 49             | 92.5               |
| JC425 | 41               | 324T                        | 14.0              | 880                  | 66000             | 256        | 49             | 108.9              |
| JC450 | 41               | 324T                        | 14.0              | 880                  | 69000             | 271        | 49             | 108.9              |
| JC475 | 50               | 326T                        | 16.0              | 1012                 | 76500             | 262        | 49             | 125.2              |
| JC525 | 50               | 326T                        | 16.0              | 1012                 | 80000             | 278        | 49             | 125.2              |

\* For static pressure from ¼ to ½ ESP use next size larger motor

| Model | Pump Motor<br>hp | Spray Water<br>GPM | Refrigerant Charge<br>lb |       | Approximate Weight<br>lb |           |
|-------|------------------|--------------------|--------------------------|-------|--------------------------|-----------|
|       |                  |                    | R-22                     | R-404 | Shipping                 | Operating |
| JC20  | ½                | 40                 | 47                       | 49    | 810                      | 1230      |
| JC25  | ½                | 40                 | 40                       | 41    | 910                      | 1450      |
| JC30  | ½                | 40                 | 52                       | 54    | 960                      | 1500      |
| JC38  | ½                | 50                 | 61                       | 64    | 1280                     | 1940      |
| JC46  | ½                | 50                 | 81                       | 84    | 1350                     | 2010      |
| JC52  | ½                | 50                 | 91                       | 95    | 1360                     | 2020      |
| JC58  | ½                | 50                 | 99                       | 103   | 1435                     | 2395      |
| JC63  | ¾                | 70                 | 121                      | 126   | 1940                     | 2900      |
| JC72  | ¾                | 70                 | 138                      | 144   | 1955                     | 2915      |
| JC80  | ¾                | 70                 | 150                      | 156   | 2074                     | 3483      |
| JC90  | 1                | 110                | 142                      | 149   | 2965                     | 4190      |
| JC110 | 1                | 110                | 188                      | 196   | 3090                     | 4560      |
| JC120 | 1                | 110                | 230                      | 240   | 3305                     | 4919      |
| JC135 | 2                | 150                | 236                      | 246   | 4355                     | 6335      |
| JC165 | 2                | 150                | 312                      | 326   | 4610                     | 6680      |
| JC180 | 2                | 150                | 354                      | 369   | 4860                     | 7020      |
| JC200 | 2                | 150                | 393                      | 410   | 4880                     | 7040      |
| JC240 | 3                | 270                | 437                      | 456   | 6675                     | 10200     |
| JC270 | 3                | 270                | 498                      | 516   | 7045                     | 10900     |
| JC285 | 3                | 270                | 522                      | 544   | 7075                     | 11200     |
| JC320 | 3                | 325                | 455                      | 478   | 7725                     | 11900     |
| JC350 | 3                | 325                | 484                      | 580   | 8180                     | 12900     |
| JC375 | 5                | 365                | 599                      | 604   | 9160                     | 15700     |
| JC400 | 5                | 365                | 748                      | 753   | 9660                     | 16300     |
| JC425 | 5                | 400                | 705                      | 710   | 10070                    | 17700     |
| JC450 | 5                | 400                | 881                      | 888   | 10660                    | 18500     |
| JC475 | 5                | 450                | 817                      | 824   | 11005                    | 19800     |
| JC525 | 5                | 450                | 1015                     | 1022  | 11700                    | 20700     |

The JC Series unit model selection may be obtained by using one of two methods presented. The simplest method is based on evaporator ton load and is *intended for open type reciprocating compressor applications*.

The second method is selected by total heat of rejection which provides a more comprehensive and accurate procedure. In addition to selecting units for open type reciprocating compressor systems, this method may be applied to selecting condensers for systems with centrifugal, hermetic reciprocating or rotary screw type compressors.

**EVAPORATOR TON METHOD**

The JC condenser model numbers in **Table 1** are equal to the unit capacity in evaporator tons at standard conditions for refrigerant 12, 22 and 502 at 105°F condensing temperature, 40°F suction temperature, and 78°F wet bulb temperature.

When selecting a unit for non-standard conditions, enter **Table 2**, Page 7, to select capacity correction factors and multiply times the system evaporator ton load. Select the standard unit model number which is greater than or equal to this product.

From **Table 4** Capacity Factor at 75° F wet bulb and 105°F Cond. = .93.

**EXAMPLE**

|        |                        |         |
|--------|------------------------|---------|
| Given: | Evaporator Load, R-22  | 81 Tons |
|        | Entering Air Wet Bulb  | 72°F    |
|        | Condensing Temperature | 105°F   |
|        | Suction Temperature    | 30°F    |

Determine Condenser Selection:

From **Table 2** Capacity Factor at 72°F wet bulb and 105°F Cond. = .86.

Suction Pressure Capacity Factor at 30°F = 1.03.

$81 \text{ Tons} \times .86 \times 1.03 = 71.7 \text{ corrected tons}$

Select Model **JC72** since its model number is greater than the design corrected evaporator load.

**TABLE NO. 1: Standard Conditions**

| JC Model Number and Capacity |    |    |    |    |    |    |    |    |    |    |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
|------------------------------|----|----|----|----|----|----|----|----|----|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| 20                           | 25 | 30 | 38 | 46 | 52 | 58 | 63 | 72 | 80 | 90 | 110 | 120 | 135 | 165 | 180 | 200 | 240 | 270 | 285 | 320 | 350 | 375 | 400 | 425 | 450 | 475 | 525 |

Based on standard conditions for refrigerants R-12, R-22 and R-502 at 105°F cond., 40° suction, 78° WB.

JC Series is not applicable for ammonia systems.

**TABLE NO. 2: Evaporator Capacity Factors**

| Non-Standard Conditions — Refrigerants R12, R22, R500 and R502 |       |                            |                            |      |      |      |      |      |      |      |      |      |      |      |
|--|-------|----------------------------|----------------------------|------|------|------|------|------|------|------|------|------|------|------|
| Cond. Pressure<br>PSIG   |       | Cond.<br>Temperature<br>°F | Wet Bulb Temperature<br>°F |      |      |      |      |      |      |      |      |      |      |      |
| R12  | R22   |                            | 50                         | 55   | 60   | 65   | 68   | 70   | 72   | 75   | 78   | 80   | 85   | 90   |
| 91.8   | 155.7 | 85                         | 1.05                       | 1.16 | 1.33 | 1.61 | 1.87 | 1.98 | 2.26 | 2.80 |      |      |      |      |
| 99.8   | 168.4 | 90                         | .90                        | .98  | 1.11 | 1.28 | 1.43 | 1.54 | 1.72 | 1.96 | 2.33 | 2.70 |      |      |
| 108.3  | 181.8 | 95                         | .75                        | .85  | .93  | 1.04 | 1.12 | 1.18 | 1.28 | 1.39 | 1.59 | 1.75 | 2.50 |      |
| 117.2  | 195.9 | 100                        | .70                        | .75  | .81  | .88  | .93  | .97  | 1.03 | 1.11 | 1.22 | 1.32 | 1.70 | 2.53 |
| 126.6  | 210.8 | 105                        | .63                        | .66  | .70  | .76  | .79  | .83  | .86  | .93  | 1.00 | 1.05 | 1.27 | 1.67 |
| 136.4  | 226.4 | 110                        | .57                        | .60  | .63  | .67  | .70  | .72  | .75  | .80  | .85  | .89  | 1.02 | 1.26 |
| 146.8  | 242.7 | 115                        |                            | .54  | .57  | .60  | .63  | .64  | .66  | .69  | .73  | .75  | .84  | .99  |
| 157.7  | 259.9 | 120                        |                            |      |      | .53  | .55  | .56  | .58  | .60  | .63  | .65  | .70  | .81  |

**Evap Load x Factors = Corrected Tons**

| Suction Pressure Capacity Factors |              |      |      |      |      |      |      |      |      |
|-----------------------------------|--------------|------|------|------|------|------|------|------|------|
| <b>Suction Pressure</b>           | <b>R-12</b>  | 0.6  | 4.5  | 9.2  | 14.6 | 21.0 | 28.5 | 37.0 | 46.7 |
|                                   | <b>R-22</b>  | 10.2 | 16.5 | 24.0 | 32.8 | 43.0 | 54.9 | 68.5 | 84.0 |
|                                   | <b>R-502</b> | 15.5 | 22.8 | 31.2 | 41.1 | 52.5 | 65.4 | 80.2 | 96.9 |
| <b>Suction Temperature</b>        | <b>°F</b>    | -20  | -10  | 0    | +10  | +20  | +30  | +40  | +50  |
| <b>Capacity Factor</b>            |              | 1.32 | 1.23 | 1.17 | 1.11 | 1.07 | 1.03 | 1.00 | .97  |

**HEAT OF REJECTION METHOD**

Many times, the specification for an evaporative condenser will be expressed in "Total Heat Rejection" (THR) at the condenser, rather than the net refrigeration effect at the evaporator. Basically, total heat rejection is the sum of the compressor capacity in BTUH and the heat corresponding to the brake horsepower (BHP) in BTUH for open type compressors or to the kilowatt (kW) input in BTUH for hermetic compressors.

Where the "Total Heat Rejection" is not specified, it can be readily calculated by using the following formulas:

**Open Type Compressor:**

$$\text{THR} = \text{Compressor Evaporator Capacity (BTUH)} + \text{Compressor bhp} \times 2545$$

**Hermetic Compressor:**

$$\text{THR} = \text{Compressor Evaporator Capacity (BTUH)} + \text{Compressor kW} \times 3413$$

The selection procedure for this method is similar to that given for the evaporator ton method once the heat of rejection requirements are known. Enter **Table 4** and select a capacity factor per design condensing temperature and entering air wet bulb. Multiply the factor times the system total heat of rejection. Select the unit model from **Table 3** whose heat of rejection is greater than or equal to this product.

**EXAMPLE:**

Given:

|                                |               |
|--------------------------------|---------------|
| Compressor Evaporator Capacity | 51 Tons       |
| Wet Bulb Temperature           | 75°F          |
| Condensing Temperature         | 105°F         |
| Type Compressor                | Hermetic R-22 |
| Compressor KW Input            | 49.0 kW       |

Determine Condenser Selection:

Heat of Rejection

$$51 \text{ Tons} \times 12,000 = 612,000 \text{ BTUH}$$

$$49.0 \text{ kW} \times 3413 = 167,000 \text{ BTUH}$$

$$\text{Total Heat Rejection} = 779,000 \text{ BTUH}$$

From **Table 4** Capacity Factor at 72°F wet bulb and 105°F Cond. = .86

$$779,000 \text{ BTUH} \times .93 = 724,470 \text{ BTUH approx. (724.5 MBH)}$$

Select Model **JC52** condenser since its nominal total heat rejection is greater than or equal to the required THR.

**Table 3 — Nominal Total Heat Rejection – MBH**

| Model | Heat Rejection<br>MBH* | Model | Heat Rejection<br>MBH* |
|-------|------------------------|-------|------------------------|
| JC20  | 294.0                  | JC165 | 2425.5                 |
| JC25  | 367.5                  | JC180 | 2646.0                 |
| JC30  | 441.0                  | JC200 | 2940.0                 |
| JC38  | 558.6                  | JC240 | 3528.0                 |
| JC46  | 676.2                  | JC270 | 3969.0                 |
| JC52  | 764.4                  | JC285 | 4189.0                 |
| JC58  | 852.6                  | JC320 | 4689.3                 |
| JC63  | 926.1                  | JC350 | 5203.8                 |
| JC72  | 1058.4                 | JC375 | 5513.0                 |
| JC80  | 1176.0                 | JC400 | 5880.0                 |
| JC90  | 1323.0                 | JC425 | 6336.0                 |
| JC110 | 1617.0                 | JC450 | 6762.0                 |
| JC120 | 1764.0                 | JC475 | 7159.0                 |
| JC135 | 1984.5                 | JC525 | 7644.0                 |

\*Based on standard conditions for refrigerants R-12, R-22 and R-502 at 105°F cond., 40° suction, 78° WB.



**TABLE NO. 4: Heat Rejection Capacity Factors**

| Non-Standard Conditions — Refrigerants 12, 22, 500 and 502 |       |                   |                            |      |      |      |      |      |      |      |      |      |      |      |
|--|-------|-------------------|----------------------------|------|------|------|------|------|------|------|------|------|------|------|
| Cond. Pressure<br>PSIG                                     |       | Temperature<br>°F | Wet Bulb Temperature<br>°F |      |      |      |      |      |      |      |      |      |      |      |
| R12  | R22   |                   | 50                         | 55   | 60   | 65   | 68   | 70   | 72   | 75   | 78   | 80   | 85   | 90   |
| 76.9   | 133.5 | 75                | 1.46                       | 1.66 | 1.96 | 2.51 | 3.11 | 3.46 | 4.26 |      |      |      |      |      |
| 84.1   | 145.0 | 80                | 1.26                       | 1.41 | 1.64 | 2.03 | 2.44 | 2.69 | 3.19 | 3.93 | 4.02 |      |      |      |
| 91.8   | 155.7 | 85                | 1.10                       | 1.22 | 1.39 | 1.67 | 1.94 | 2.13 | 2.45 | 2.94 | 3.02 | 3.63 |      |      |
| 99.8   | 168.4 | 90                | .93                        | 1.02 | 1.14 | 1.32 | 1.47 | 1.59 | 1.75 | 2.00 | 2.38 | 2.75 | 3.34 |      |
| 108.3  | 181.8 | 95                | .80                        | .87  | .95  | 1.08 | 1.16 | 1.22 | 1.32 | 1.45 | 1.61 | 1.79 | 2.56 | 3.09 |
| 117.2  | 195.9 | 100               | .71                        | .76  | .82  | .89  | .93  | 1.00 | 1.03 | 1.12 | 1.23 | 1.33 | 1.72 | 2.50 |
| 126.6  | 210.8 | 105               | .63                        | .66  | .70  | .76  | .79  | .83  | .86  | .93  | 1.00 | 1.05 | 1.27 | 1.61 |
| 136.4  | 226.4 | 110               | .56                        | .59  | .62  | .66  | .70  | .71  | .75  | .79  | .84  | .88  | 1.01 | 1.19 |
| 146.8  | 242.7 | 115               |                            | .52  | .55  | .58  | .60  | .62  | .64  | .67  | .70  | .73  | .81  | .92  |
| 157.7  | 259.9 | 120               |                            |      |      | .51  | .53  | .54  | .55  | .57  | .60  | .62  | .68  | .75  |

**Total Heat of Rejection x Factor = Nominal Total Heat Rejection**

**BASIC CONSTANTS**

- 500 = Thermal capacity water in BTUH/°F/GPM  
= 8.33 (lb/gallon water x 1.0 (specific heat of water at 60°F) x 60 (minutes/hour))
- 0.075 = weight one cubic foot standard air (lb)
- 4.5 = pounds of air/hour/cfm  
= .075 (weight one cubic foot standard air) x 60 (minutes/hour)
- 0.242 = specific heat of air (BTU/pound/°F)
- 1.09 = 4.5 (pounds of air/hour/cfm x 0.242 (specific heat of air, BTU/pound/°F))

**Subcooling:**

Standard subcooling coil conditions are 78°W.B., 105° entering liquid, 95° leaving liquid or 10° subcooling.

JC Series Evaporative Condensers are designed for applications where a multiple of refrigeration systems are connected to a single unit. The JC Series Evaporative Condensers can be furnished from the factory having the condenser coil divided into individual refrigerant circuits, each sized to meet a specified capacity. Each circuit is supplied with a hot gas inlet connection and liquid outlet connection, each tagged for identification.

The procedure for selecting a multi-circuited condenser coil is described in the "Selection Example," as outlined below. For circuit identification purposes it is required that circuits be arranged in numerical sequence. The connections for the individual circuits, will be **numbered at the factory, from left to right when facing connection end of unit**, with the number 1 circuit being on the extreme left.

**Selection Example:**

Given:

Condensing Temperature 100°F.

Entering Air Wet Bulb Temp. 72°F.

Ten individual suction cooled hermetic compressors operating at suction temperatures and compressor capacities, as shown in the tabulation below.

**Procedure**

1. Tabulate data in Columns 1, 2 and 3, making sure circuits are in correct numerical sequence.
2. From **Table 5**, "Hermetic Compressors," select Evaporator Temperature Capacity Factor applicable to each Suction Temperature listed in Column 2 and tabulate in Column 4.
3. From **Table 7**, select "Condenser Capacity Conversion Factor" applicable to the design condensing temperature and the design entering air wet bulb temperature and tabulate in Column 5.

4. Multiply figures in Columns 3, 4 and 5 for each circuit, and tabulate in Column 6.
5. Add all the capacities in Column 6, to arrive at the Total Adj. BTUH to Nominal required and use the total to select the proper size condenser.

**Selection**

The total Adj. BTUH to Nominal capacity, for the four refrigeration systems, of 994,900 BTUH, **Table 6** shows the smallest unit that will meet the requirement is Model **JC72** with a THR of 1,058,400 BTUH. To determine the number of tube circuits required for each sequence number circuit divide Column 6 by Column 7, for each circuit and tabulate in Column 8. If the decimal part of the tube circuit requirement is less than .3, drop the decimal and enter the whole number in Column 9. If the decimal part is equal to or greater than .2, round off to the next higher whole number and enter in Column 9.

The "Tabulation Sample" shows 33 tube circuits are required, for this example, and **Table 6** shows that Model **JC72** has 33 tube circuits available, therefore, is the proper unit selection.

**NOTE:**

If the summation of the number of tube circuits assigned to the individual circuits is less than the total number of tube circuits available in the unit, by inspection, add enough tubes to effect a balance. If the summation of the number of tube circuits assigned to the individual circuits is greater than the total number of tube circuits available in the unit by inspection, delete enough tubes to effect a balance. However, if such reduction causes more than a 10% reduction in any of the circuits, go to the next larger unit size and reassign tube circuits to give adequate capacity to every circuit.

**Tabulation Example**

| 1              | 2                      | 3                   | x | 4                                    | x | 5                                     | = | 6                    | / | 7                                  | = | 8                           | 9                       |
|----------------|------------------------|---------------------|---|--------------------------------------|---|---------------------------------------|---|----------------------|---|------------------------------------|---|-----------------------------|-------------------------|
| Circuit Number | Suction Temperature °F | Comp. Capacity BTUH | x | Evap. Temp. Cap. Conversion Table 11 | x | Cond. Cap. Conversion Factor Table 12 | = | Adj. BTUH to Nominal | / | Capacity Per Tube Circuit Table 10 | = | Number of Circuits Required | Number of Circuits Used |
| 1              | -20                    | 108,600             | x | 1.79                                 | x | 1.03                                  | = | 200,200              | / | 32,070                             | = | 6.24                        | 7                       |
| 2              | +10                    | 90,700              | x | 1.51                                 | x | 1.03                                  | = | 141,100              | / | 32,070                             | = | 4.40                        | 5                       |
| 3              | +20                    | 185,400             | x | 1.45                                 | x | 1.03                                  | = | 276,900              | / | 32,070                             | = | 8.63                        | 9                       |
| 4              | +40                    | 275,000             | x | 1.33                                 | x | 1.03                                  | = | 376,700              | / | 32,070                             | = | 11.75                       | 12                      |
|                |                        |                     |   |                                      |   |                                       |   | <b>994,900</b>       |   |                                    |   |                             | <b>33</b>               |

**Table 5 – Evaporative Temperature Capacity Conversion Factor**

| Evaporative Temperature °F | -40  | -30  | -25   | -20  | -15  | -10  | -5   | 0    | 5    | 10   | 15   | 20   | 25   | 30   | 35   | 40   | 45   | 50   |
|----------------------------|------|------|-------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| Open Compressors           | 1.75 | 1.65 | 1.62  | 1.59 | 1.55 | 1.53 | 1.50 | 1.47 | 1.44 | 1.40 | 1.37 | 1.35 | 1.32 | 1.30 | 1.28 | 1.26 | 1.24 | 1.22 |
| Hermetic Compressors       | 2.02 | 1.90 | 1.852 | 1.79 | 1.74 | 1.69 | 1.65 | 1.61 | 1.57 | 1.51 | 1.48 | 1.45 | 1.40 | 1.36 | 1.34 | 1.33 | 1.32 | 1.31 |

Table 6 – Total Heat Rejection Capacity

| Model Number | Number of Tube Circuits Available | at 105°F Cond. Temperature, 78°F WB Temperature<br>Refrigerants R12, R22 and R502 |                       |
|--------------|-----------------------------------|---|-----------------------|
|              |                                   | Total Unit BTUH   | BTUH per Tube Circuit |
| JC20         | 19                                | 294,000   | 15,470                |
| JC25         | 21                                | 367,500   | 17,500                |
| JC30         | 21                                | 441,000   | 21,000                |
| JC38         | 26                                | 558,600   | 21,485                |
| JC46         | 26                                | 676,200   | 26,000                |
| JC52         | 26                                | 764,400   | 29,400                |
| JC58         | 26                                | 852,600   | 32,790                |
| JC63         | 33                                | 926,100   | 28,060                |
| JC72         | 33                                | 1,058,400   | 32,070                |
| JC80         | 33                                | 1,176,000   | 35,636                |
| JC90         | 82                                | 1,323,000   | 16,130                |
| JC110        | 82                                | 1,617,000   | 19,220                |
| JC120        | 82                                | 1,764,000   | 21,510                |
| JC135        | 100                               | 1,984,500   | 19,845                |
| JC165        | 100                               | 2,425,500   | 24,255                |
| JC180        | 100                               | 2,646,000   | 26,460                |
| JC200        | 100                               | 2,940,000   | 29,400                |
| JC240        | 140                               | 3,528,000   | 25,200                |
| JC270        | 140                               | 3,969,000   | 28,350                |
| JC285        | 140                               | 4,189,500   | 29,925                |
| JC320        | 140                               | 4,689,300   | 33,495                |
| JC350        | 140                               | 5,203,800   | 37,170                |
| JC375        | 152                               | 5,513,000   | 36,270                |
| JC400        | 152                               | 5,880,000   | 38,680                |
| JC425        | 152                               | 6,336,000   | 41,680                |
| JC450        | 152                               | 6,762,000   | 44,490                |
| JC475        | 152                               | 7,159,000   | 47,100                |
| JC525        | 152                               | 7,644,000   | 50,290                |

Note: Models JC240 through JC525 coil arrangements provide two equal circuits as standard.

Table 7 – Condenser Capacity Conversion Factors

| Refrigerants 12, 22, 500 and 502 |       |                            |                            |      |      |      |      |      |      |      |      |      |      |      |
|----------------------------------|-------|----------------------------|----------------------------|------|------|------|------|------|------|------|------|------|------|------|
| Cond. Pressure<br>PSIG           |       | Cond.<br>Temperature<br>°F | Wet Bulb Temperature<br>°F |      |      |      |      |      |      |      |      |      |      |      |
| R12                              | R22   |                            | 50                         | 55   | 60   | 65   | 68   | 70   | 72   | 75   | 78   | 80   | 85   | 90   |
| 76.9                             | 133.5 | 75                         | 1.46                       | 1.66 | 1.96 | 2.51 | 3.11 | 3.46 | 4.26 |      |      |      |      |      |
| 84.1                             | 145.0 | 80                         | 1.26                       | 1.41 | 1.64 | 2.03 | 2.44 | 2.69 | 3.19 | 3.93 | 4.02 |      |      |      |
| 91.8                             | 155.7 | 85                         | 1.10                       | 1.22 | 1.39 | 1.67 | 1.94 | 2.13 | 2.45 | 2.94 | 3.02 | 3.63 |      |      |
| 99.8                             | 168.4 | 90                         | .93                        | 1.02 | 1.14 | 1.32 | 1.47 | 1.59 | 1.75 | 2.00 | 2.38 | 2.78 | 3.34 |      |
| 108.3                            | 181.8 | 95                         | .80                        | .87  | .95  | 1.08 | 1.16 | 1.22 | 1.32 | 1.45 | 1.61 | 1.79 | 2.56 | 3.09 |
| 117.2                            | 195.9 | 100                        | .71                        | .76  | .82  | .89  | .93  | 1.00 | 1.03 | 1.12 | 1.23 | 1.33 | 1.72 | 2.50 |
| 126.6                            | 210.8 | 105                        | .63                        | .66  | .70  | .76  | .79  | .83  | .86  | .93  | 1.00 | 1.05 | 1.27 | 1.61 |
| 136.4                            | 226.4 | 110                        | .56                        | .59  | .62  | .66  | .70  | .71  | .75  | .79  | .84  | .88  | 1.01 | 1.19 |
| 146.8                            | 242.7 | 115                        | .49                        | .52  | .55  | .58  | .60  | .62  | .64  | .67  | .70  | .73  | .81  | .92  |
| 157.7                            | 259.9 | 120                        | .41                        | .45  | .48  | .51  | .53  | .54  | .55  | .57  | .60  | .62  | .68  | .75  |

**CAPACITY CONTROLS**

**Dual Fan Motors**—The dual fan motor package is available as a proven energy saving capacity control option. It consists of furnishing a high efficiency motor, a 1200 RPM, low speed motor, two sets of drives and belts, extended fan shaft and motor bases on opposite sides of the blower. A UL control-starter panel is available as a completely wired package for one point connection.

**Variable Speed Drive**—A Variable Speed Drive automatically minimize the tower’s noise level during periods of reduced load and/or reduced ambient temperature without sacrificing the system’s ability to maintain a constant cold water temperature. This is a relatively inexpensive solution, and can pay for itself quickly in reduced energy costs.

**Electric Damper Controls**—An electric damper control package is available as an accessory for modulating the internal damper system. A proportional solid state actuator is factory mounted below the fan scroll and attached to the damper shaft by connecting linkage. A sensing bulb connected to the actuator by a capillary tube is normally mounted in the unit pan water basin for monitoring the system. However, when specified, a pressure control may be supplied for field mounting to allow direct head pressure control. An end switch located inside the motor actuator may be adjusted to cycle the fan motor on for pressure rise and off when dampers close.

**ELECTRONIC WATER LEVEL CONTROL**

The electronic water level control package provides a constant and accurate means of monitoring water level in the unit. For this reason, it is often recommended for those installations which require year round operation in low ambient conditions.

The complete package includes an electric float switch with stilling chamber which is factory installed in the pan section of the unit. An electric solenoid valve for water make-up is shipped loose for remote installation. All wiring must be provided in the field by others.

**PAN HEATER**

The use of a remote sump tank located indoors is a common form of pan water freeze protection for evaporative cooling equipment. However, for those installations which will not allow this type of system, freeze protection may be provided by electric immersion heaters or steam or hot water coils installed in the pan.

The electric heater package consists of immersion heaters installed in the pan to provide efficient even heat distribution. Standard heaters are selected to provide approximately 40°F pan water at -10°F ambient temperature. A low water cutout switch is supplied to prevent heater operation when the elements are not completely submerged. The heaters are monitored by a sump thermostat with remote sensing bulb located in the pan water. All heaters and controls are factory installed for field wiring by others.

**NOTE:** *Pan heater packages are designed to prevent pan water freezing during unit shutdown with fans and pump idle.*

**SUB-COOLING COILS**

The sub-cooling coil accessory consists of an additional coil section located below the standard condensing coil. All coils are leak tested to 350 PSIG under water.

The sub-cooling coil is intended for halocarbon refrigerant applications which specify sub-cooling or system design. In some cases sub-cooling is needed to prevent excessive refrigerant flash off due to a vertical rise in liquid lines or high pressure drop.

The standard design for a sub-cooling section provides approximately 10°F of sub-cooling at standard conditions for halocarbon refrigerants.

**VIBRATION ISOLATORS**

Spring type vibration isolator rails may be supplied for field installation: some units will require base frame structural support.

**STAINLESS STEEL CONSTRUCTION**

300 stainless steel construction is offered as an option for sump pan and upper casing panels.



RECOLD  
 550 W MERCURY LANE  
 BREA, CA USA 92821  
 714 529 6080  
 spxcooling@spx.com  
[spxcooling.com](http://spxcooling.com)

In the interest of technological progress, all products are subject to design and/or material change without notice.  
 ©2011 SPX | Printed in USA  
**RECOLD JC-TECH-11**